



WATER LINE INSTALL / ALTER / REPLACE

WHEN LOCAL WATER PRESSURE IS IN EXCESS OF 80 LBS./SQ. IN (P.S.I.) - AN APPROVED PRESSURE REDUCING VALVE SHALL BE INSTALLED, AND THE PRESSURE REDUCED TO 80 P.S.I. OR LESS

IF PIPE PASSES THROUGH FOUNDATION WALL, A PROTECTIVE SLEEVE WILL BE REQUIRED
PIPE MAY BE LAID UNDER THE EXTERIOR FOOTING

NON-METALLIC THREADED ADAPTORS SHALL BE MALE THREAD ONLY

FILL CLEAN GRAVEL SAND OR DIRT

FULL WAY SHUT-OFF VALVE GATE OR BALL VALVE

FOUNDATION WALL

PIPE SIZE TO BE 3/4" MINIMUM


BLUE TRACER WIRE 18 GAUGE OR HEAVIER REQUIRED ON THE ENTIRE LENGTH OF NON METALLIC PIPE

DEPTH OF PIPE TO BE 24" MINIMUM BELOW FINISHED GRADE

PROPERTY LINE

APPROVED MATERIALS FOR WATER LINE INTO BLDG.



WATER METER & BOX SUPPLIED BY CITY OF LEBANON

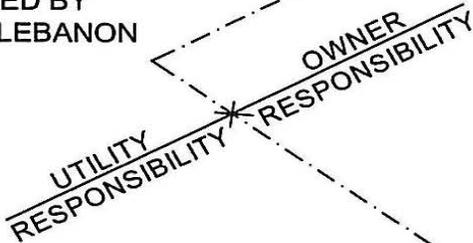

- ⊕ PVC SCH. 40
- ⊕ PVC SCH. 80
- PEX
- ⊕ PE (POLYETHYLENE)
- CPVC
- COPPER TYPE K
- COPPER TYPE L
- * COPPER TYPE M
- GALV. PIPE (MACHINE WRAPPED ONLY)

- ⊕ ALLOWED OUTSIDE OF BUILDING ONLY
- * (NOT PERMITTED UNDERGROUND BENEATH THE STRUCTURE)

THE CITY THAT FRIENDLINESS BUILT

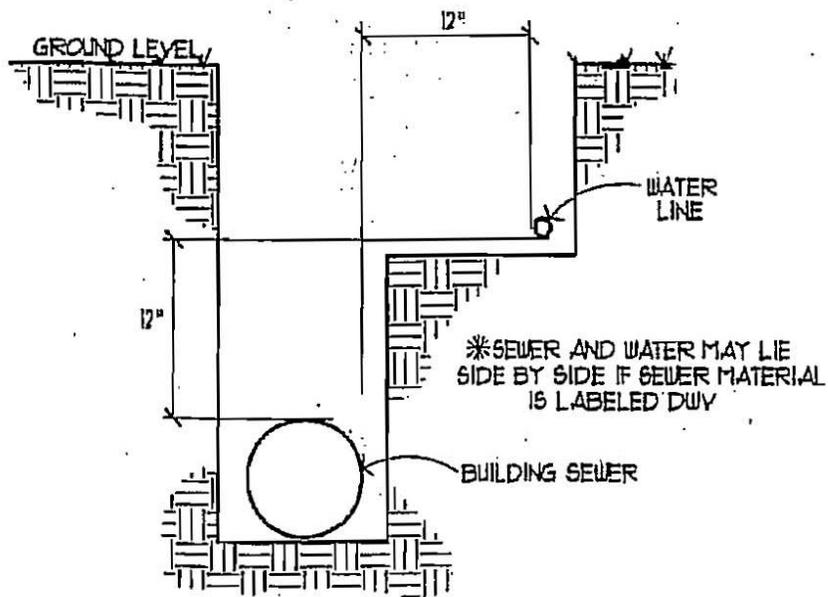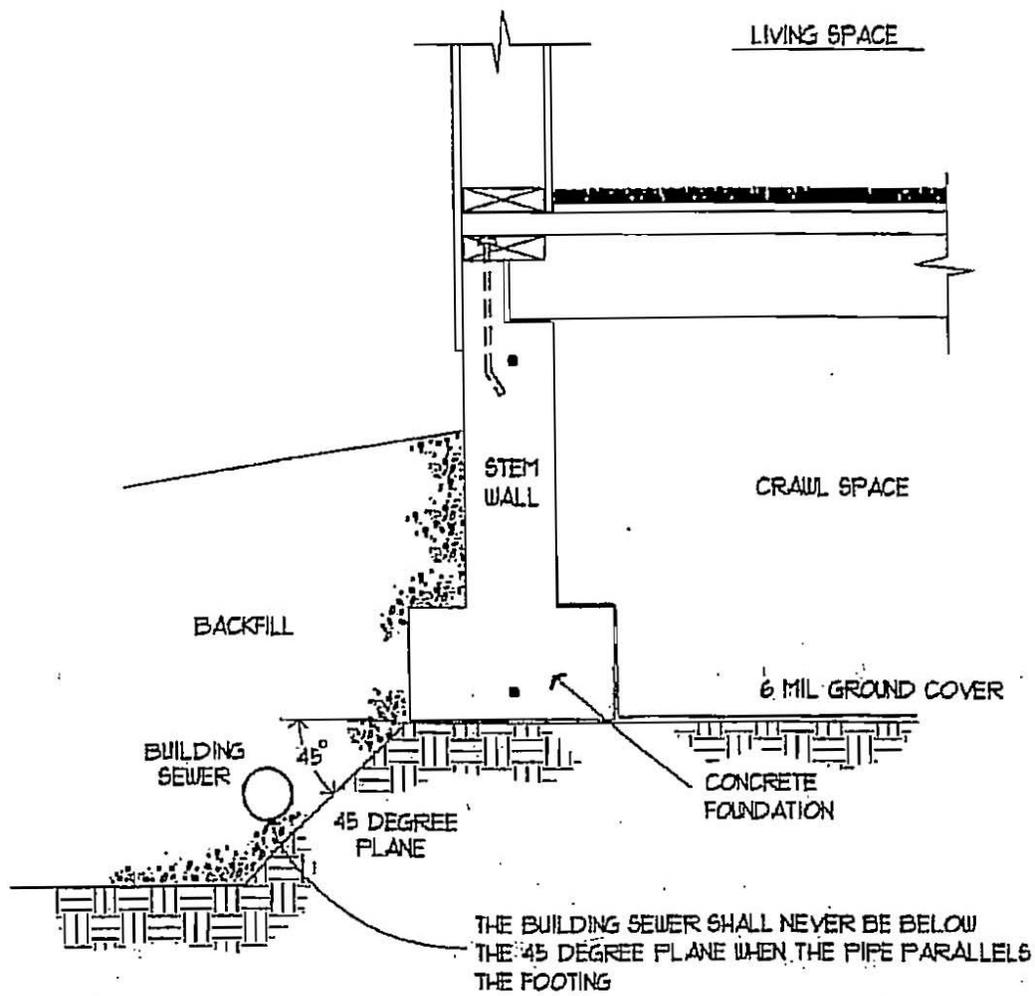

THE CITY THAT FRIENDLINESS BUILT