


NOTES:

1. ALL CONCRETE SHALL BE COMMERCIAL GRADE CONCRETE.
2. PRECAST CONCRETE CATCH BASINS MAY BE USED WHEN SPECIFIED OR APPROVED.
3. FOR GRATE DETAILS SEE STD DWG 00400-09.
4. APRON REINFORCEMENT SHALL CONSIST OF #4 REBAR @ 12" ON CENTER (TYP.) MAINTAIN 2" COVER ON ALL BARS.
5. RUNOFF DETENTION REQUIRED ON PRIVATE INLETS CONNECTED DIRECTLY TO THE CITY STORM SYSTEM.

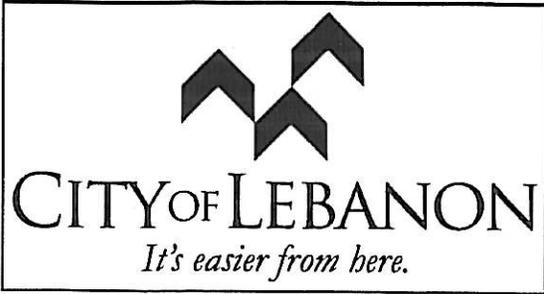

| | | |
|--|---|--|
| CITY of LEBANON SUPPLEMENTAL DRAWING | | |
| <p>APPROVED</p> <p style="text-align: center;"><i>Damir H. Hammad</i></p> <p>CITY ENGINEER</p> | <p>MODIFIED TYPE G-2MA INLET</p> | <p>DATE: Jan. 2009</p> <p>DRAWING NO: 00400-06</p> |