




END VIEW

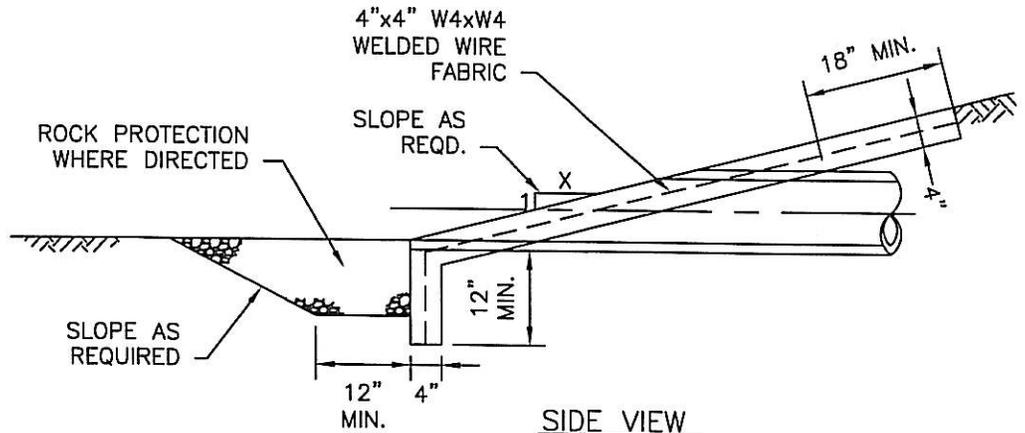

SIDE VIEW



SECTION A-A

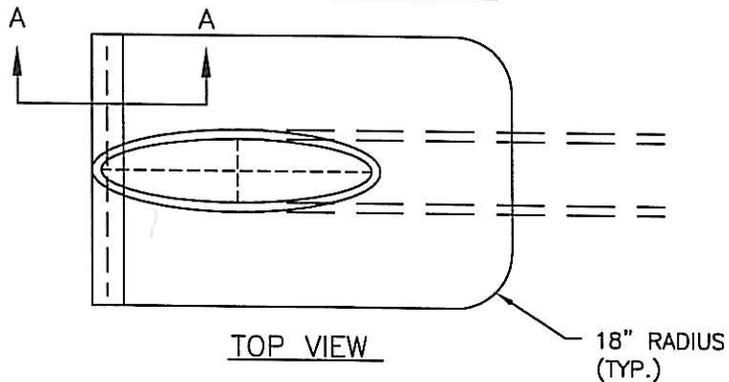

TOP VIEW

NOTES:

1. ALL EXPOSED CONCRETE EDGES SHALL BE CHAMFERED 3/4" UNLESS NOTED OTHERWISE. SLOPE PAVING SURFACE VARIATIONS SHALL NOT EXCEED 3/8" IN 10'.
2. ALL METAL REINFORCEMENT SHALL BE PLACED 1 1/2" CLEAR OF NEAREST FACE OF CONCRETE UNLESS SHOWN OR NOTED OTHERWISE.
3. ALL CONCRETE SHALL BE COMMERCIAL GRADE CONCRETE.
4. CLEAR SPACING FOR MULTIPLE PIPE INSTALLATIONS SHALL BE ONE HALF THE DIAMETER OF SPAN BUT NOT LESS THAN 18".



CITY of LEBANON SUPPLEMENTAL DRAWING

APPROVED

*Donald J. Hamrick*  
CITY ENGINEER

PAVED SLOPE  
ENDS

DATE:  
Jan. 2009

DRAWING NO:  
00400-10