



END SECTION-A
(NON-TRAFFIC AREAS)

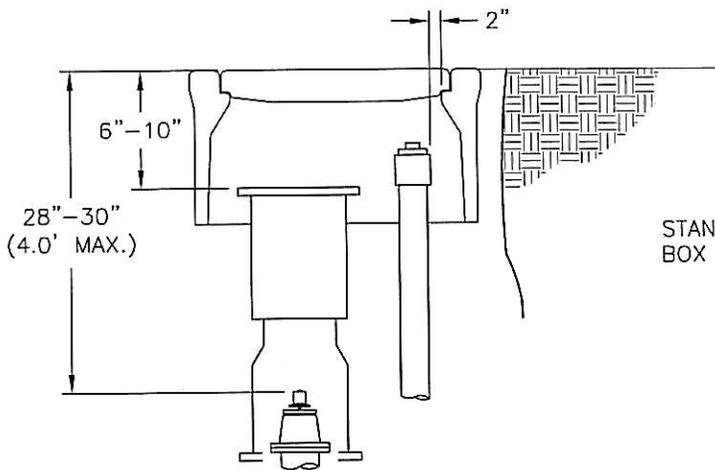

WATER METER & VALVE BOX CLEARANCES
(TYP. FOR ALL INSTALLATIONS)

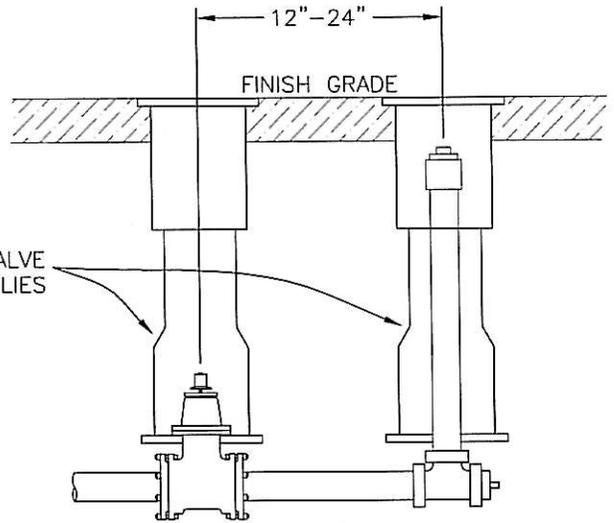

END SECTION-B
(PAVED/TRAFFIC AREAS)

NOTES:

1. IF EXISTING WATER MAIN IS UNRESTRAINED, USE THRUST BLOCKING AS REQUIRED (SEE SUPP. DWG. 01100-04).
2. ALL PIPE AND FITTINGS SHALL BE GALVANIZED IRON PIPE (G.I.P.) UNLESS OTHERWISE NOTED.



CITY of LEBANON SUPPLEMENTAL DRAWING

APPROVED

Domenic J. Hamrick
CITY ENGINEER

TYPICAL MAIN
DEAD-END BLOW-OFF
ASSEMBLY

DATE:
Jan. 2009

DRAWING NO:
01100-07